


# CITY OF AUBURNDALE FIRE HYDRANT ASSEMBLY DETAILS

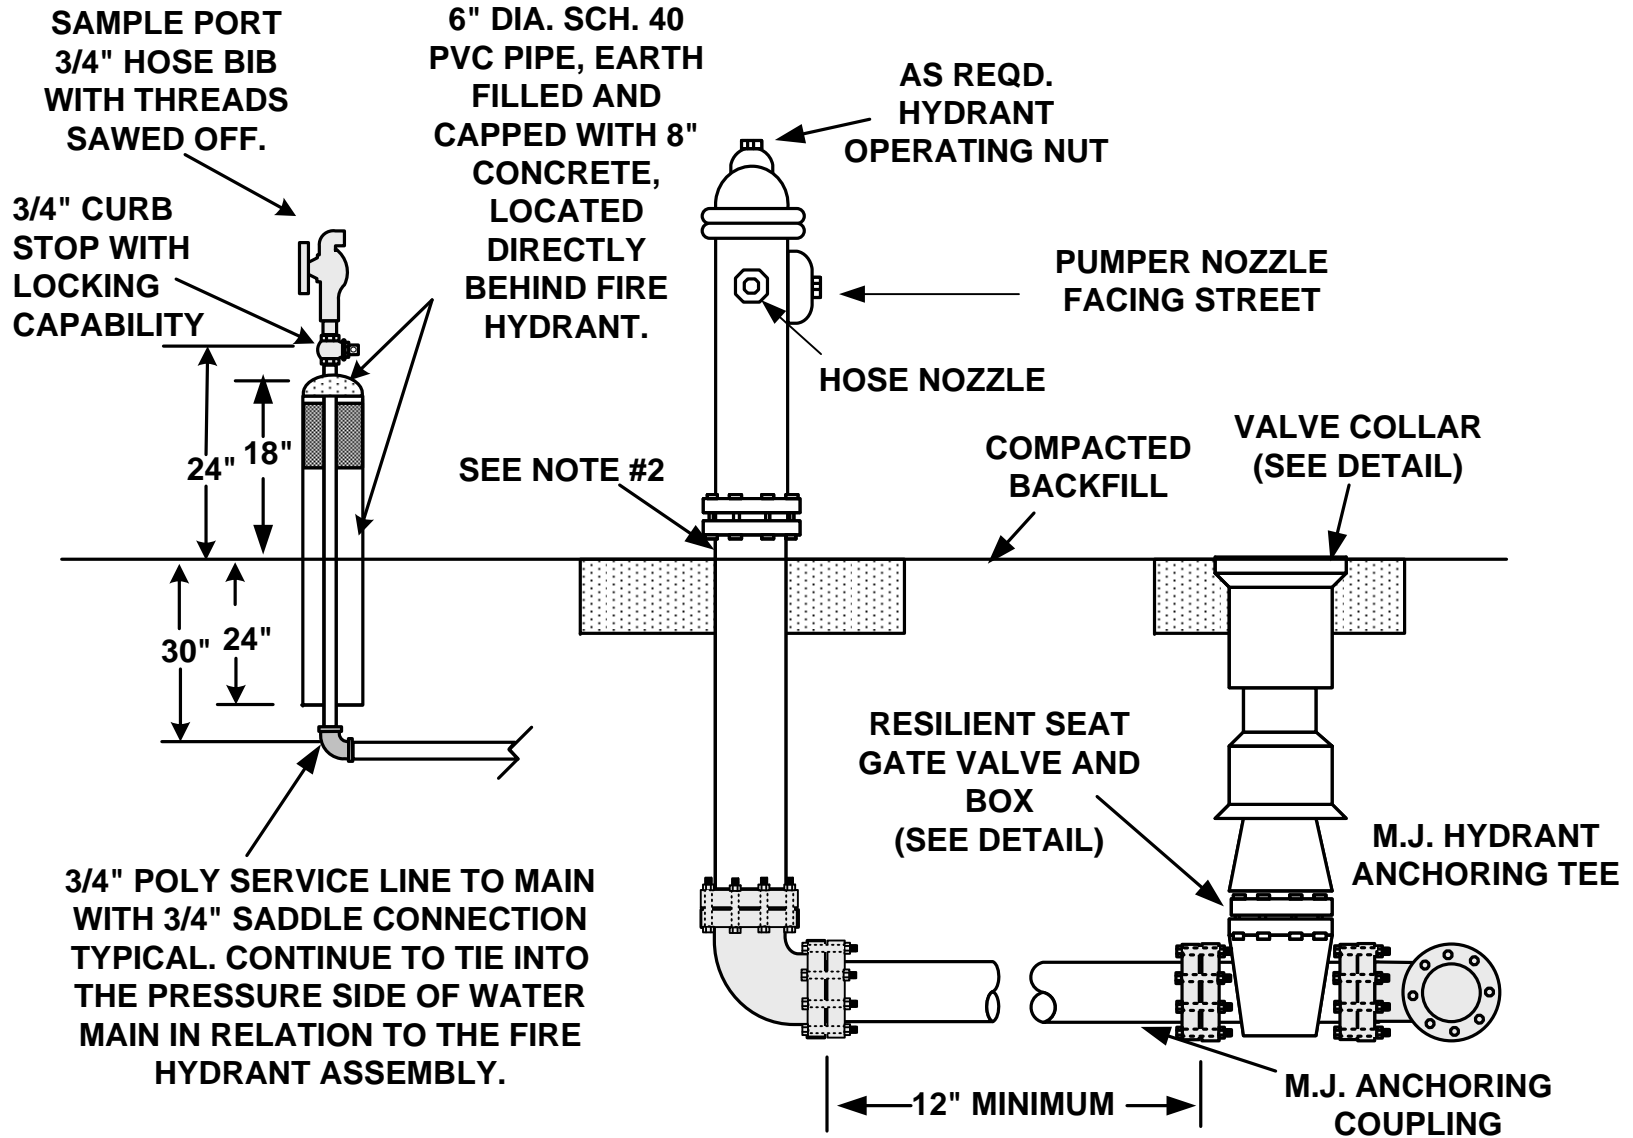

**NOTES:**

1. FIRE HYDRANT SHALL BE SUPPLIED WITH A WEEP HOLE (DRY BARREL TYPE).
2. CLEARANCE BETWEEN BOTTOM OF BOLTS AND TOP OF SHEAR PAD SHALL BE 6".
3. RESTRAINED JOINTS REQUIRED THROUGHOUT FIRE HYDRANT ASSEMBLY.