


CITY OF AUBURNDALE UTILITIES

FLUSH VALVE DETAILS

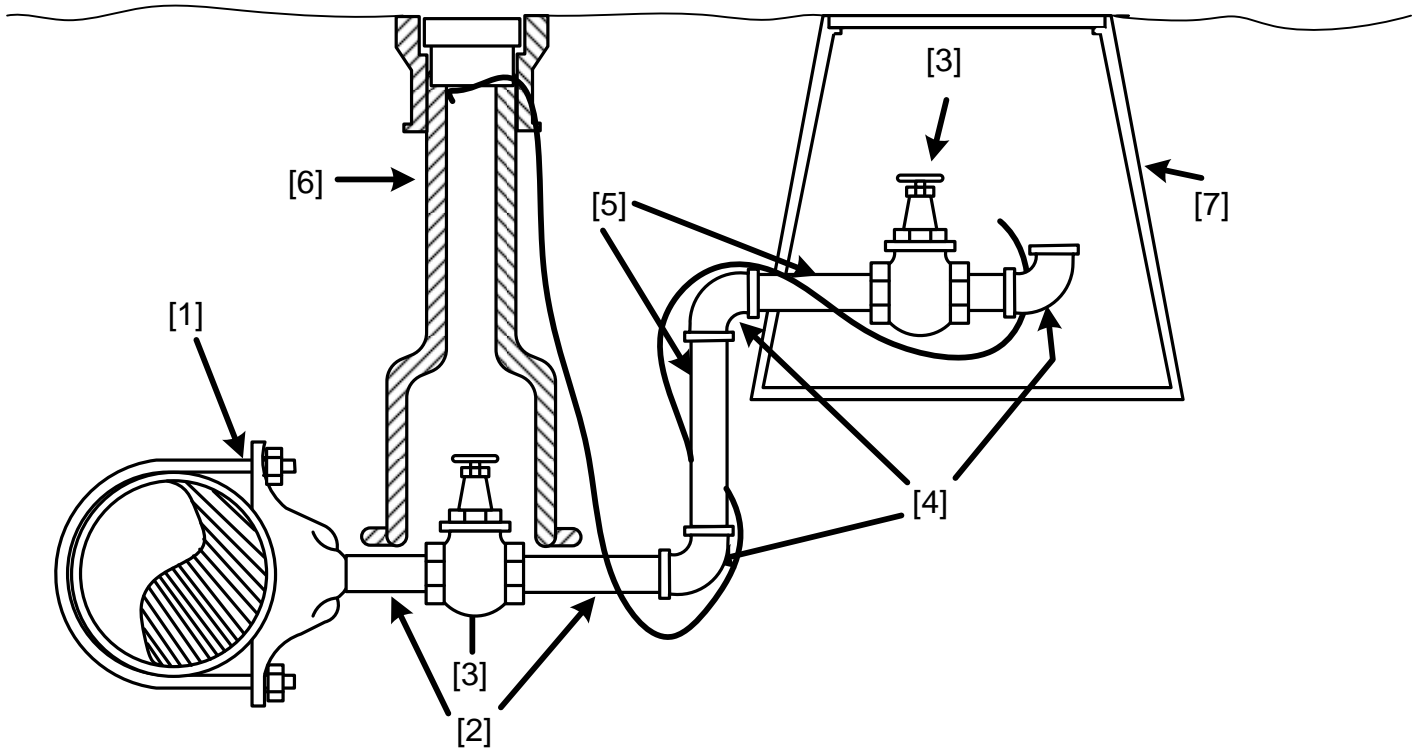

BILL OF MATERIALS			
1	1	TAPPING SADDLE	
2	3	THREADED NIPPLE, GALVANIZED	
3	2	2" BALL VALVE	
4	3	90° ELBOW, GALVANIZED	4
5	2	PIPE, GALVANIZED	4
6	1	VALVE BOX	
7	1	METER BOX	

GENERAL NOTES:

1. ADJUSTABLE VALVE BOX TO BE INSTALLED IN PAVED AREAS ONLY.
2. FIELD CONDITIONS MAY CHANGE THE LAYOUT OF THIS DRAWING.
3. ALL CHANGES SHALL BE AT THE DISCRETION OF THE WATER DEPARTMENT.
4. TRACER WIRE TO BE BROUGHT UP TO GRADE AT EVERY IN-LINE VALVE AND SERVICE VALVE. WIRE SHALL BE CONTINUOUS AND TAPED.