


CITY OF AUBURNDALE TYPICAL DROP MANHOLE DESIGN

NOTE:
OUTSIDE DROP
CONNECTION AT
MANHOLE REQUIRED
ON ALL NEW
CONSTRUCTION
WHERE INVERT DROP
EXCEEDS 2.0 FEET

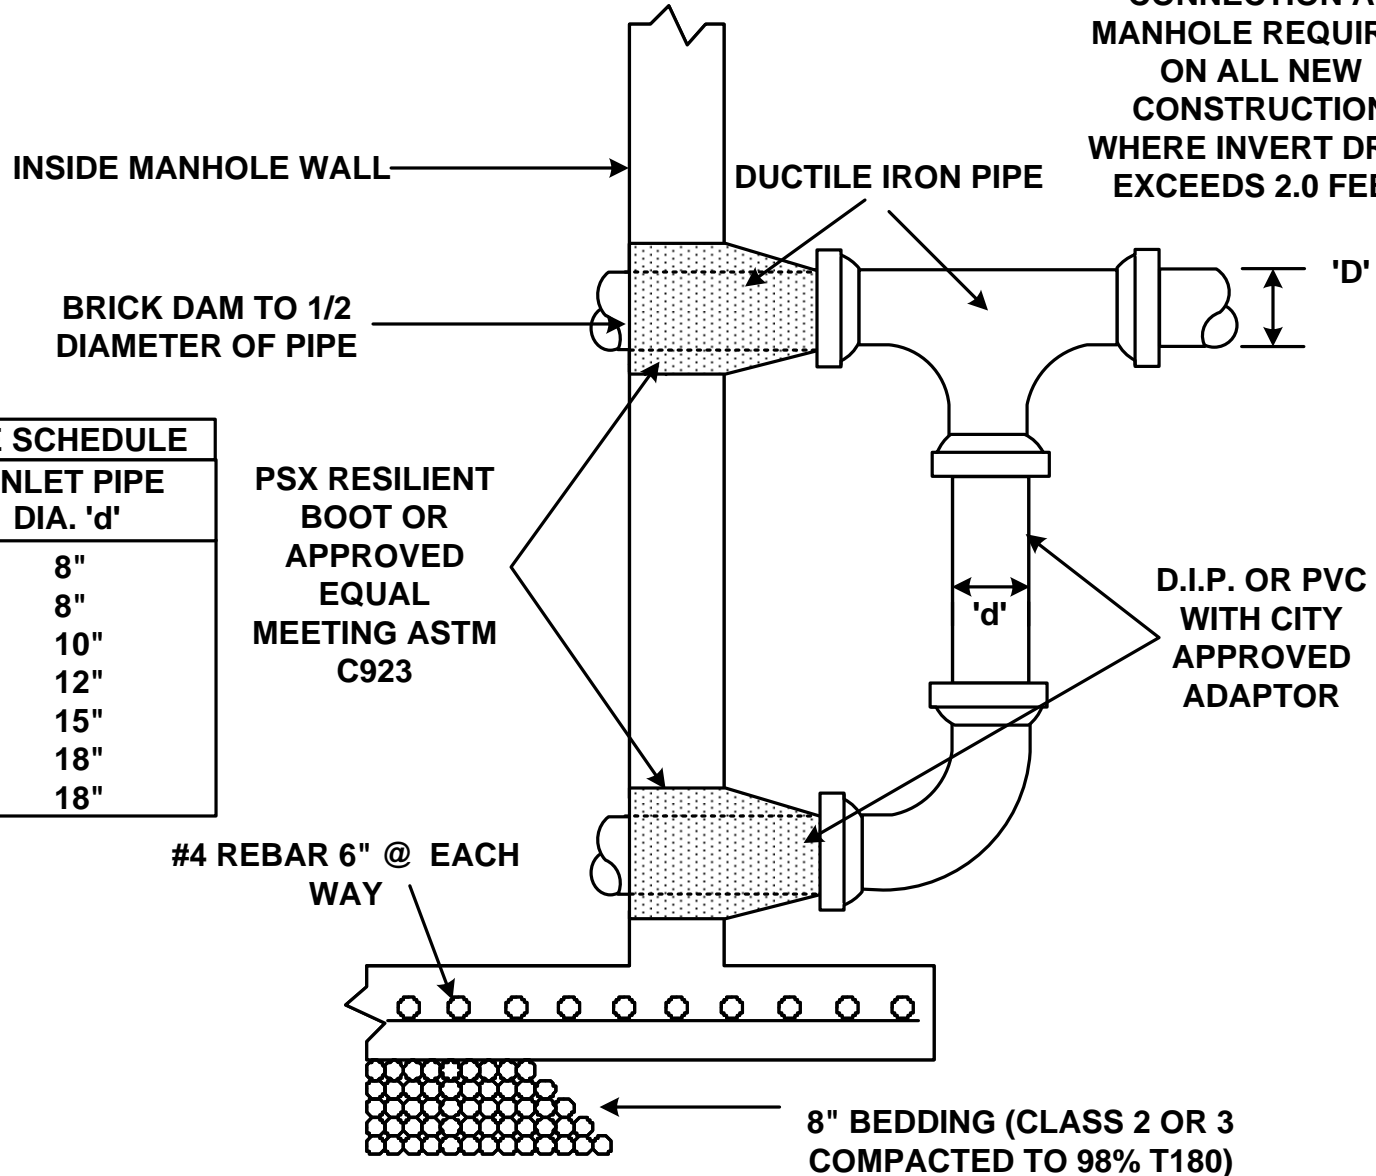

DROP MANHOLE SCHEDULE	
INLET PIPE DIA. 'D'	INLET PIPE DIA. 'd'
8"	8"
10"	8"
12"	10"
15"	12"
18"	15"
21"	18"
24"	18"

MANHOLE OUTSIDE DROP CONNECTION